


- B = Piping Taps Allowed after outlet valve
- C = Bypass required
- * = Flanges provided by Water Utility



DIMENSION "A"

- 1 1/2" Disc Meter (A=17 1/2")
- 2" Compound Meter (A=15 1/4")
- 3" Compound Meter (A=17")
- 4" Turbo Meter (A=14")
- 6" Turbo Meter (A=18")

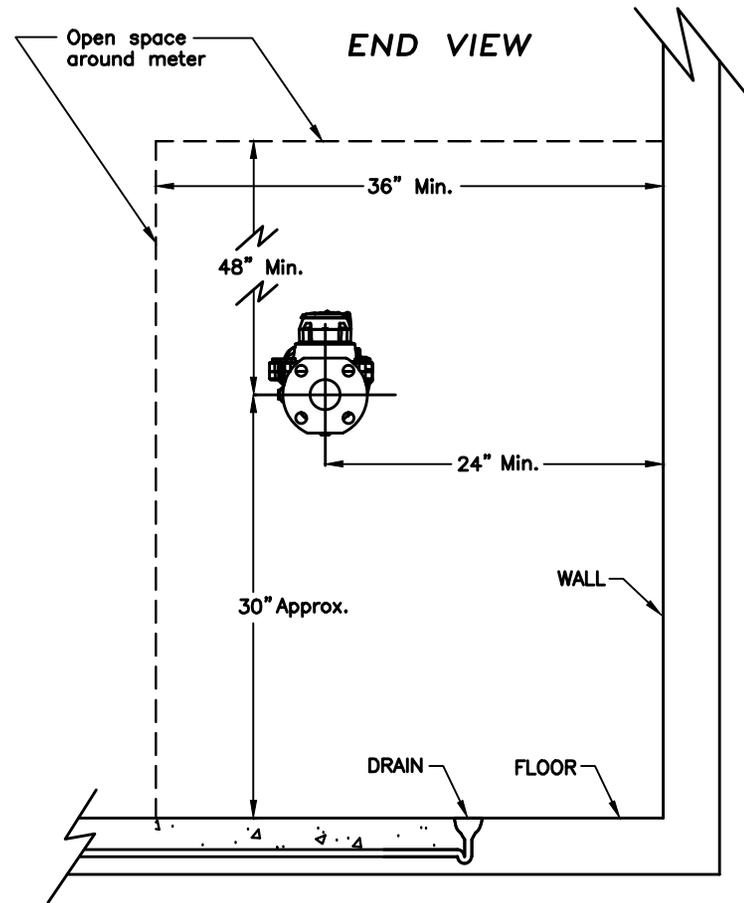

**CITY OF MIDDLETON
STANDARD DETAIL**

LARGE METER SETTINGS

REVISED 06-06-2014
DRAWN BY: SU

400-8